

Braukmann BA295S-LF

Backflow Preventer

Compact construction with threaded connectors

Application

Backflow preventers of this type are suitable for the protection of drinking water systems against back pressure, backflow and back syphonage.

They can be used for residential buildings, industrial and commercial purposes within the scope of their specification.

The backflow preventer protects drinking water for fluids up to and including liquid category 4 to EN 1717.

Approvals

- DVGW in progress
- NF in progress
- KIWA in progress
- BELGAQUA in progress
- VR in progress

Special Features

- LEAD-FREE: Pb content of all materials less than 0.1 %
- Optimal protection of the drinking water supply system
- Integrated inlet strainer
- Inlet check valve and discharge valve are combined in one cartridge
- Lead-free material
- Low maintenance effort cartridge insert and valve insert are completely replaceable
- Optimized design prevents water stagnation in normal operation
- Compact construction
- · Easy access to all internal components
- Low pressure loss and high flow rate
- REACH and RoHS conform
- ACS certified
- All materials are KTW approved
- Approved by TÜV LGA for low noise, Group 1 without limitation
- 5-year warranty




Technical Data

| Media | | | | | | |
|----------------------------|--|--|--|--|--|--|
| Medium: | Drinking water | | | | | |
| Connections/Sizes | | | | | | |
| Connection size: | ¹ / ₂ " - 2" | | | | | |
| Discharge pipe connection: | DN50 for connection sizes 1/2" - 11/4" DN70 for connection sizes 11/2" - 2" | | | | | |
| Pressure values | | | | | | |
| Inlet pressure: | 1.5 bar - 10.0 bar | | | | | |
| Operating temperatures | | | | | | |
| Max. operating temperature | 65 °C | | | | | |
| medium: | (WRAS 60 °C) | | | | | |
| Specifications | | | | | | |
| Installation position: | Horizontal with discharge valve downwards | | | | | |

Construction

Overview

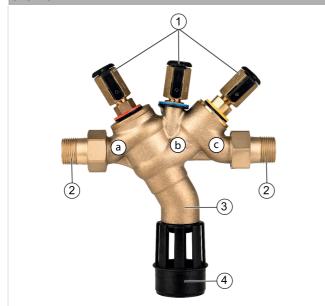

Method of Operation

BA type backflow preventers are divided into three pressure zones. The pressure in zone (a) is higher than in zone (b), which in turn is higher than in zone . A discharge valve is connected to zone **b** which opens at the latest when the differential pressure between zones (a) and (b) drops to 0.14 bar. The water from zone (b) discharges to atmosphere, both check valves close and therefore separate zone from zone and . In this way the danger of back pressure or back syphonage into the supply network is prevented. The pipework connection is interrupted and the drinking water network is protected.

Transportation and Storage

Keep parts in their original packaging and unpack them shortly before use.

The following parameters apply during transportation and storage:

| Parameter | Value |
|---------------------------------|--------------------------|
| Environment: | clean, dry and dust free |
| Min. ambient temperature: | 5 °C |
| Max. ambient temperature: | 55 °C |
| Min. ambient relative humidity: | 25 % * |
| Max. ambient relative humidity: | 85 % * |

*non condensing


| | Components | Materials | | | | |
|---|---|--|--|--|--|--|
| 1 | Three ball valves for the connection of a differential pressure gauge | Lead-free brass | | | | |
| 2 | Connection fittings | Lead-free brass | | | | |
| 3 | Housing | Lead-free brass | | | | |
| 4 | Discharge connection | High-quality synthetic material | | | | |
| | Not depicted components: | | | | | |
| | Integral strainer, mesh size approx. 200 µm | Stainless steel | | | | |
| Valve cartridge with integral check valve and discharge valve | | High-grade synthetic material | | | | |
| | Outlet check valve | High-grade synthetic material | | | | |
| | Sealing elements | Elastomer materials suitable for drinking water | | | | |

Installation Guidelines

Setup requirements

- Install shut-off valves before and after backflow preventer
- Install in horizontal pipework with the discharge valve downwards
- Ensure good access (consider EN1717 requirements) .
 - Simplifies maintenance and inspection
- If a fine filter is not installed in the drinking water system, the installation of a filter with a mesh width of 100 μ m is recommended in front of the backflow preventer
- In case of inlet-pressure fluctuations or a inlet pressure over 10 bar, we recommend to install a pressure reducing valve upstream of the backflow preventer
- Do not install in places where flooding can occur
- The installation environment should be protected against frost and ventilated well
- Install discharge pipework which has adequate capacity
- In order to avoid flooding, it is recommended to arrange a permanent, professionally dimensioned wastewater connection
- These armatures need to be maintained regularly

Installation Example

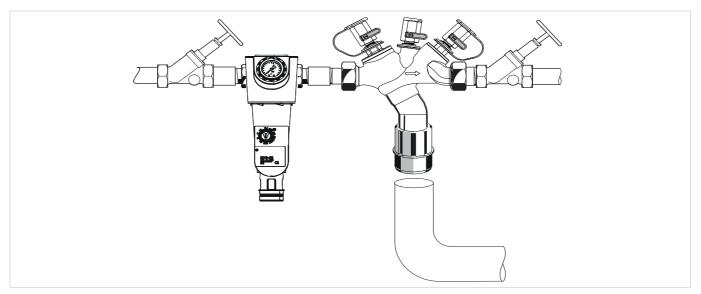

Technical Characteristics

Pressure drop characteristics


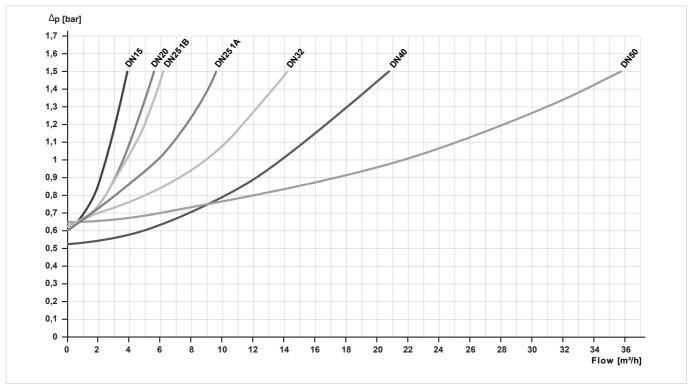


Fig. 1 Pressure drop within the valve in dependency of the flow rate and the used connection size

Dimensions

Overview

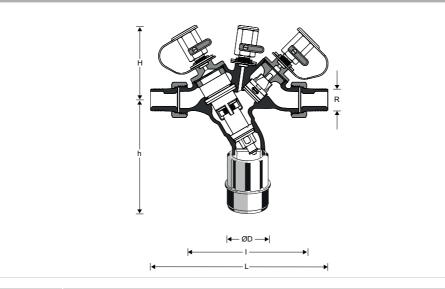

| Parameter | | | | | Values | | | |
|-------------------------|------|------------------|------------------|---------------|---------------|--------------------|--------------------|-------|
| Nominal sizes: | DN | DN 15 | DN 20 | DN 25 | DN 25 | DN 32 | DN 40 | DN 50 |
| Connection size: | R | ¹ /2" | ³ /4" | 1", B-version | 1", A-version | 1 ¹ /4" | 1 ¹ /2" | 2" |
| Discharge funnel: | ØD | 50 | 50 | 50 | 50 | 50 | 70 | 70 |
| k _{vs} -value: | m³/h | 2.4 | 3.5 | 3.5 | 5.8 | 8.5 | 13.5 | 21.0 |
| Weight: | kg | 1.6 | 1.8 | 2.1 | 2.8 | 3.3 | 5.9 | 7.2 |
| Dimensions: | L | 195 | 208 | 225 | 247 | 272 | 322 | 348 |
| | 1 | 135 | 140 | 146 | 168 | 180 | 226 | 231 |
| | Н | 88 | 88 | 88 | 103 | 103 | 126 | 126 |
| | h | 143 | 143 | 143 | 174 | 174 | 217 | 217 |

Note: All dimensions in mm unless stated otherwise.

Ordering Information

The following tables contain all the information you need to make an order of an item of your choice. When ordering, please always state the type, the ordering or the part number.

Options

The backflow preventer is available in the following sizes: 1/2", 3/4", 1", $1^{1}/4$ " $1^{1}/2$ " and 2".

- standard
- not available

| | | BA295SLFA | BA295S-1LFB |
|------------------|---|-----------|-------------|
| Connection type: | Standard version acc. EN 12729 with threaded connections $^{1}\!/_{2}$ - 2" | • | - |
| | Special version with threaded connections 1" | - | • |

Note: ... = space holder for connection size

Note: Ordering number example for 1" and type LFA valve: BA295S-1LFA


Accessories

| | Description | | Dimension | Item No. |
|--|-------------|---|---------------------------------|----------|
| | TKA295 | Test kit Analogue pressure measuring device with differential pressure display. With accessories, ideal for inspection and maintenance of backflow preventer types and the statement of the sta | | |
| | | | | ТКА295 |
| | | 3 Shut-off valve | | |
| | | | ¹ / ₂ " | 2192900 |
| | | | ³ / ₄ " | 2193100 |
| | | | 1" | 2193200 |
| | | | 1 ¹ /4" | 2193300 |
| | | | 1 ¹ / ₂ " | 2193400 |
| | | | 2" | 2193500 |

Spare Parts

Backflow preventer BA295S

Overview

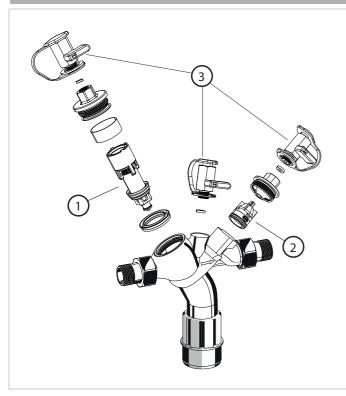

| | Description | Dimension | Item No. | | | |
|---|---------------------------|---|----------|--|--|--|
| 1 | Cartridge insert complete | | | | | |
| | | ¹ / ₂ ", ³ / ₄ ", 1" B-Version | 0904141 | | | |
| | | 1" A-Version, 1 ¹ / ₄ " | 0904142 | | | |
| | | 1 ¹ / ₂ ", 2" | 0904143 | | | |
| 2 | Check valve | | | | | |
| | | ¹ / ₂ ", ³ / ₄ ", 1" B-Version | 0904144 | | | |
| | | 1" A-Version | 0904145 | | | |
| | | 1 ¹ /4" | 0904146 | | | |
| | | 1 ¹ / ₂ " | 0904147 | | | |
| | | 2" | 0904148 | | | |
| 3 | Ball valve | | | | | |
| | | ¹ /4" | 0903412 | | | |
| | | | | | | |

resideo

Ademco 1 GmbH, Hardhofweg 40, 74821 MOSBACH, GERMANY Phone: +49 6261 810 Manufactured for and on behalf of Pittway Sàrl, Z.A., La Pièce 6, 1180 Rolle, Switzerland by its authorised representative Ademco 1 GmbH Subject to change. EN0H-1271GE23 R0824 © 2024 Resideo Technologies, Inc. All rights reserved.

For more information resideo.com

This document contains proprietary information of Pittway Sàrl and its affiliated companies and is protected by copyright and other international laws. Reproduction or improper use without specific written authorization of Pittway Sàrl is strictly forbidden.